


SYNTHETIC NATURAL GAS MIXTURES – MANUAL CHILLED MIRROR IMAGES


Gas A

Pressure = 50 bar


Assigned dewpoint = 5.0 °C

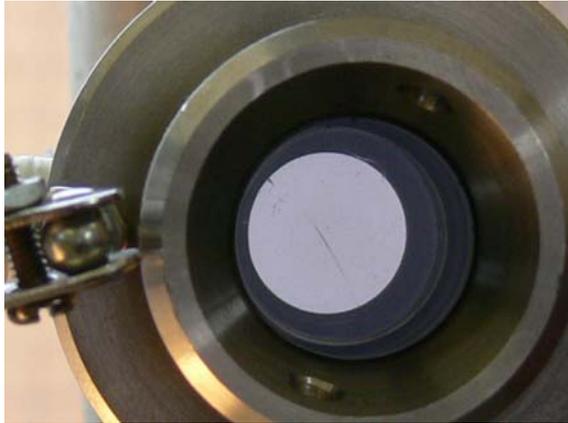


6.5 °C

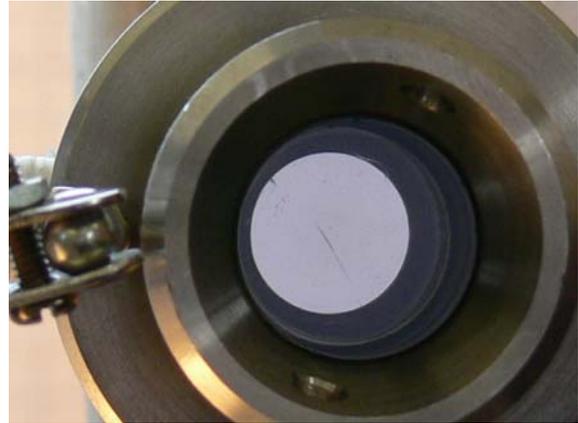


6.0 °C

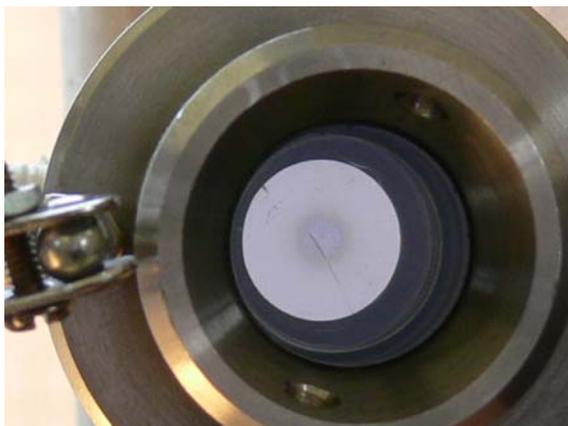


5.5 °C

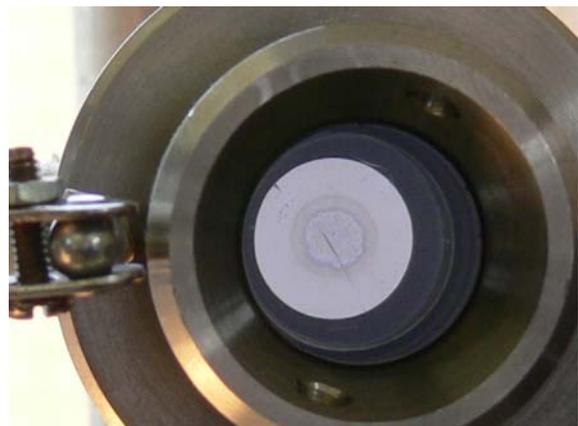

5.0 °C

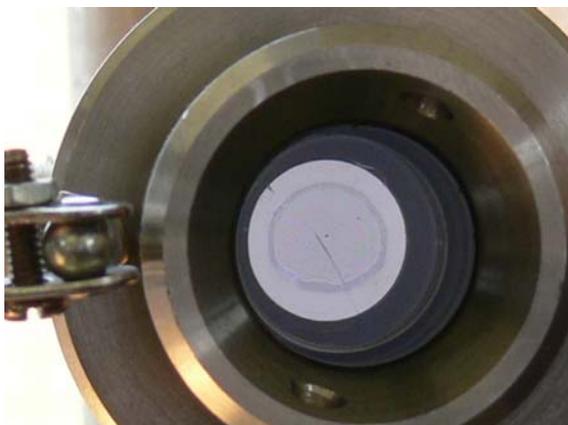

4.5 °C

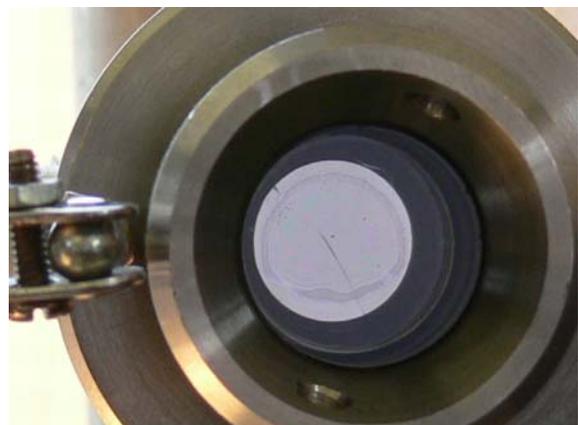

4.0 °C


Gas B

Pressure = 34 bar


Assigned dewpoint = -12.5 °C




-11.0 °C

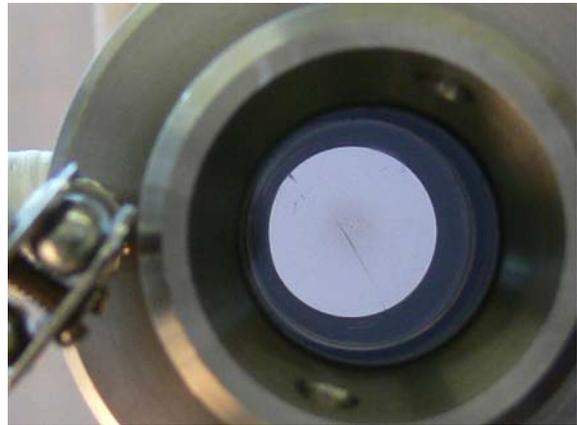


-11.5 °C

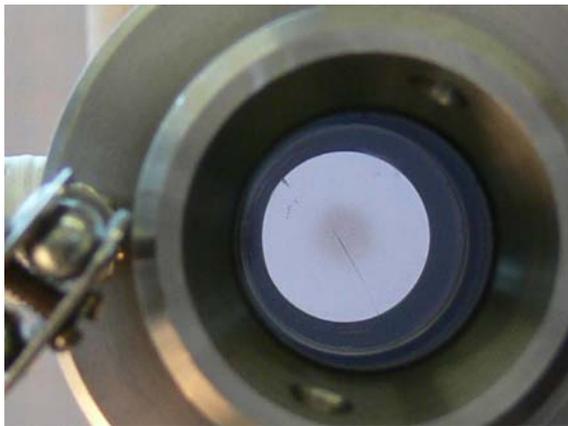


-12.0 °C

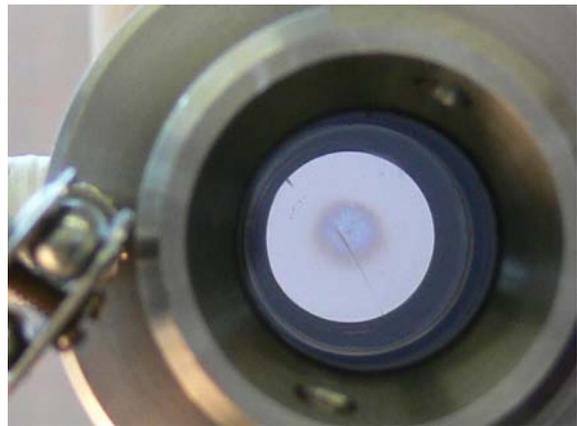

-12.5 °C

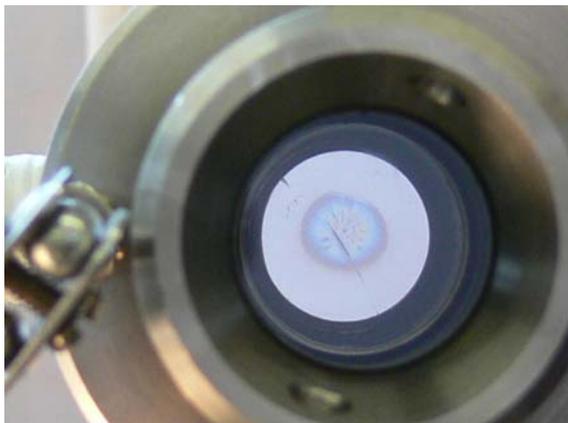

-13.0 °C

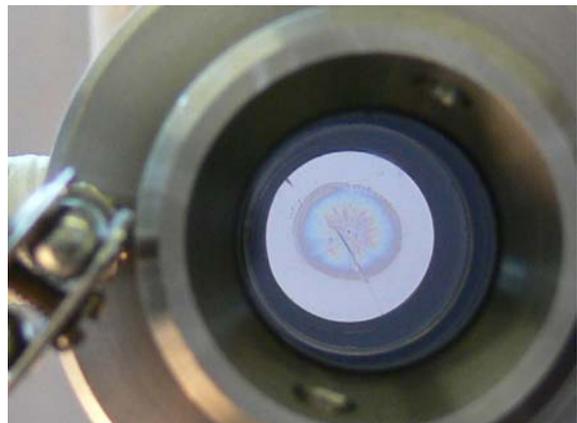


-13.5 °C


Gas C

Pressure = 32 bar


Assigned dewpoint = -4.0 °C

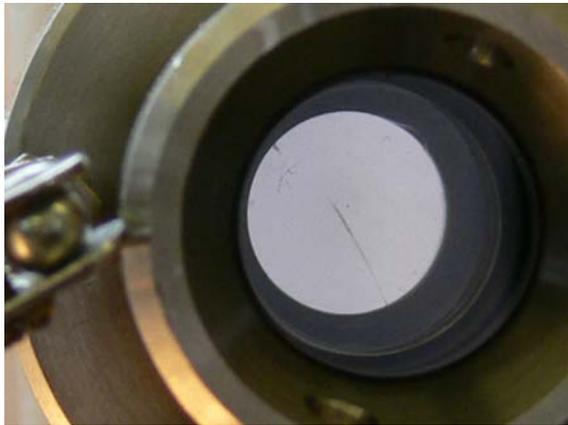


-2.5 °C

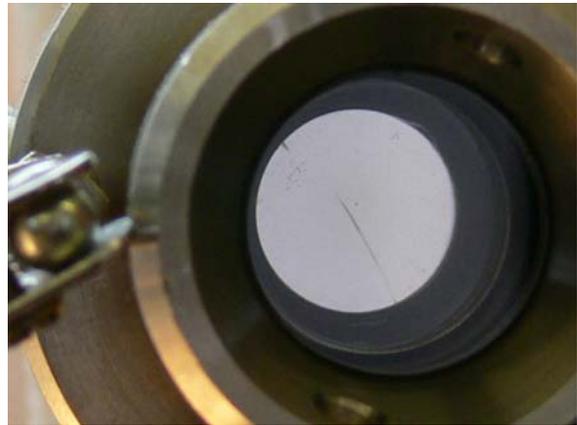


-3.0 °C

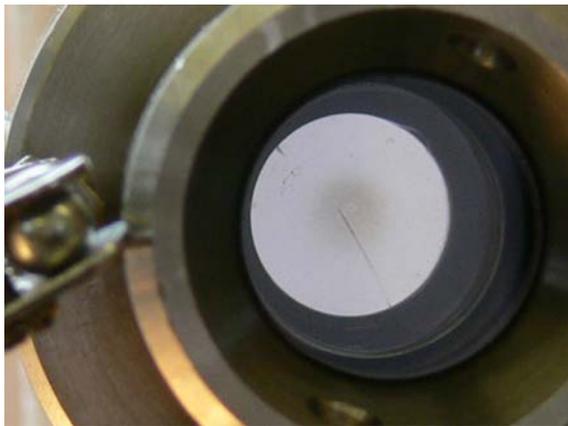


-3.5 °C

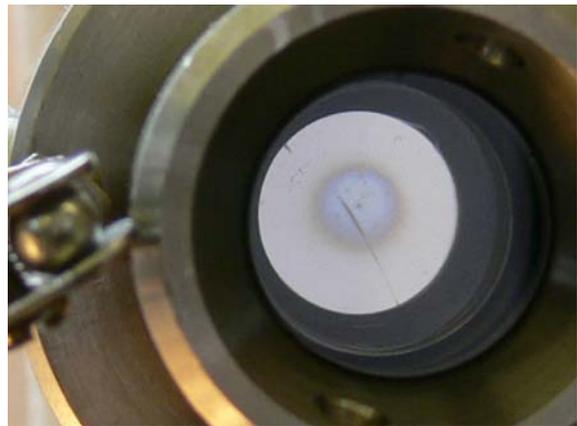

-4.0 °C

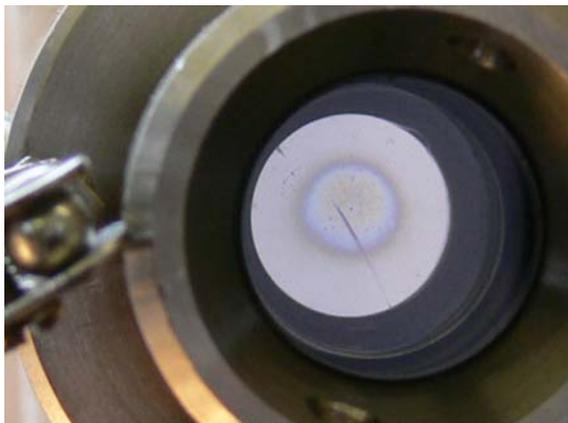

-4.5 °C

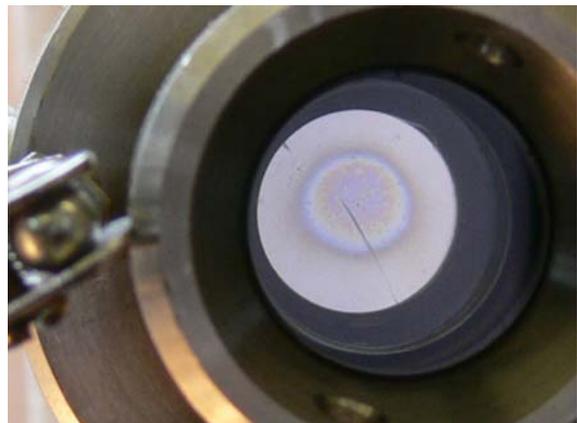


-5.0 °C


Gas D

Pressure = 39 bar


Assigned dewpoint = -6.0 °C

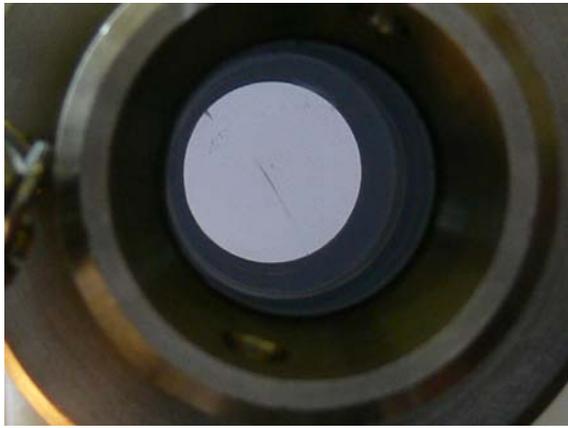


-4.5 °C

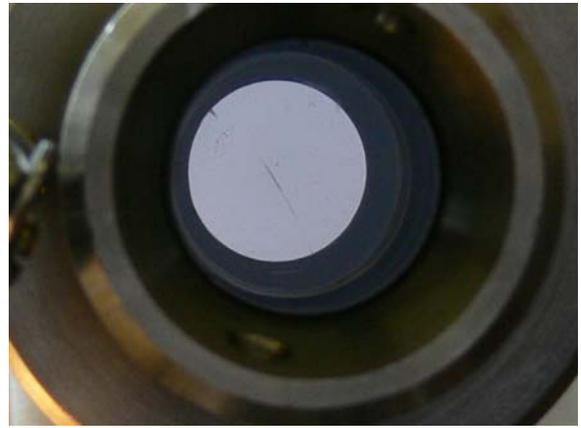


-5.0 °C

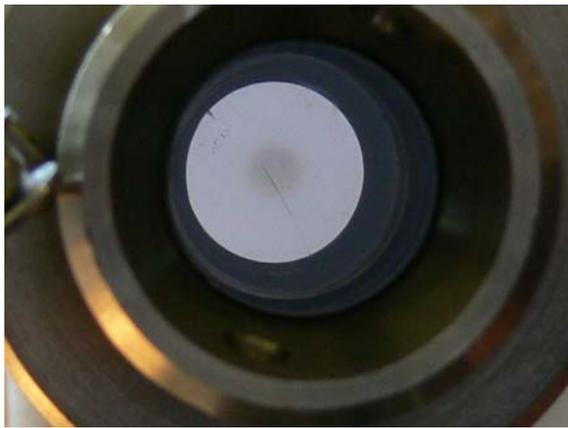


-5.5 °C

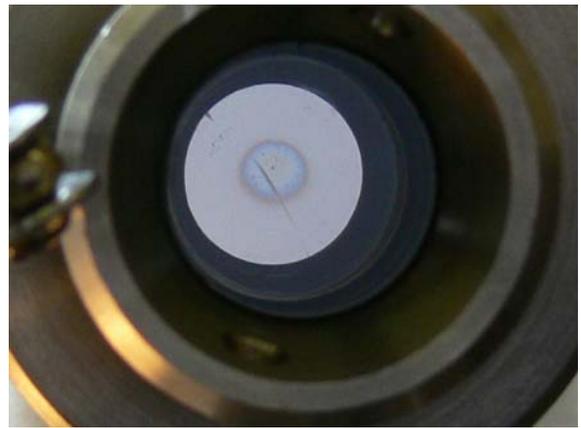

-6.0 °C

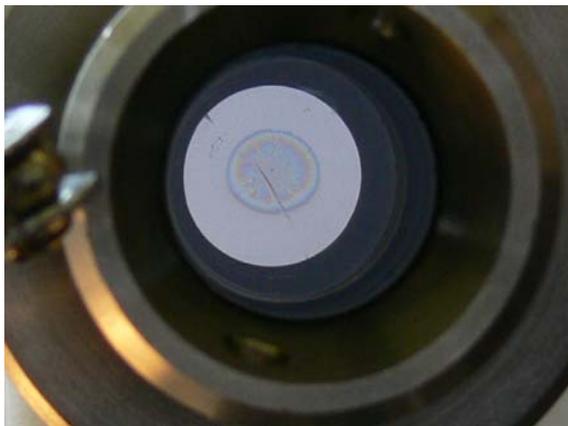

-6.5 °C

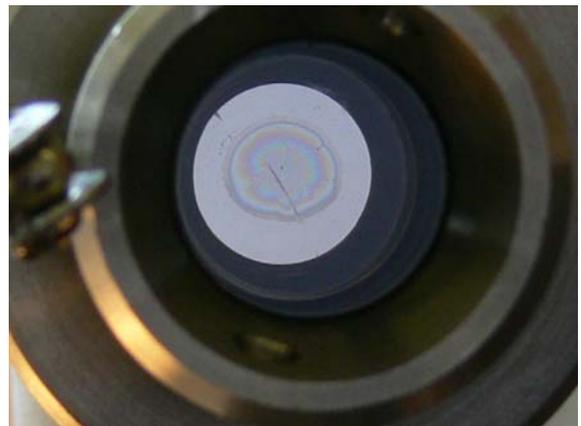


-7.0 °C


Gas E

Pressure = 46 bar

Assigned dewpoint = -41.0 °C

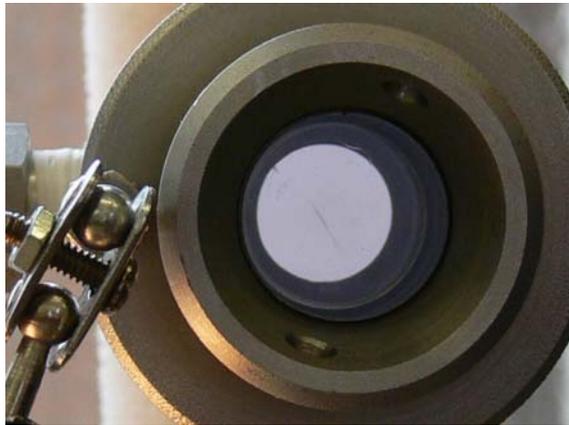

-39.5 °C

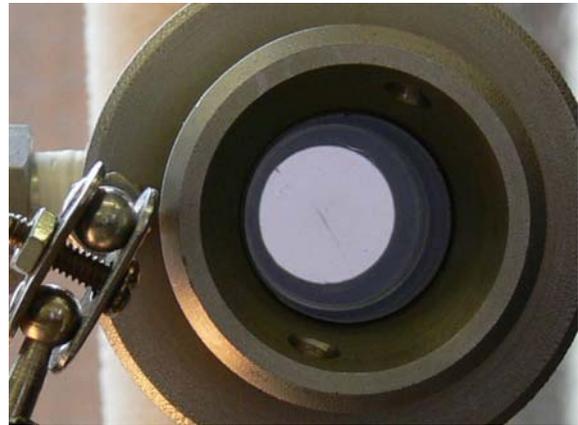

-40.0 °C



-40.5 °C



-41.0 °C



-41.5 °C




-42.0 °C


Gas F

Pressure = 38 bar


Assigned dewpoint = -27.5 °C

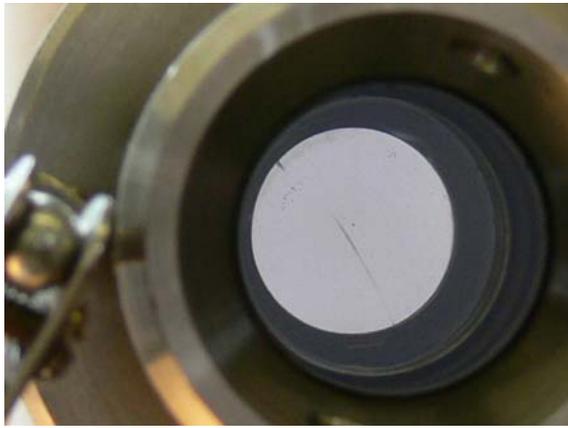


-26.0 °C

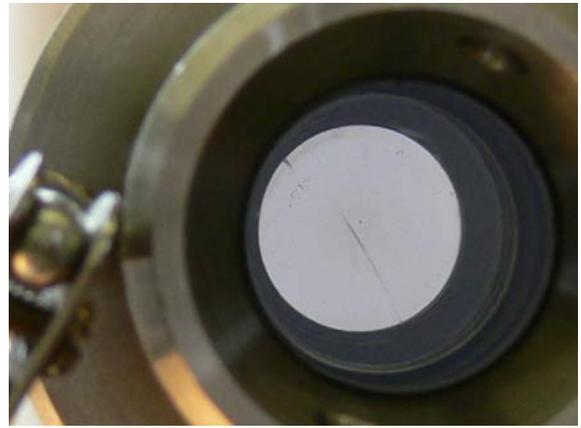


-26.5 °C

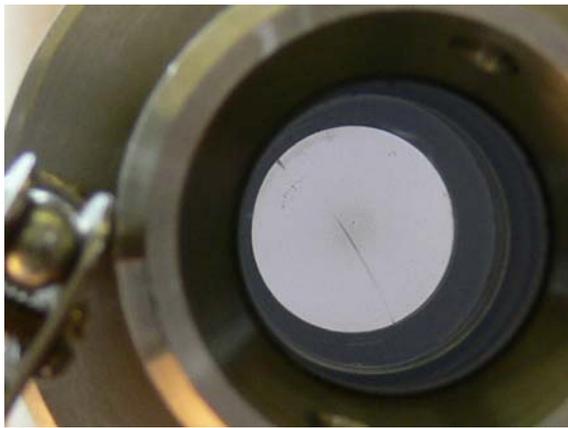


-27.0 °C

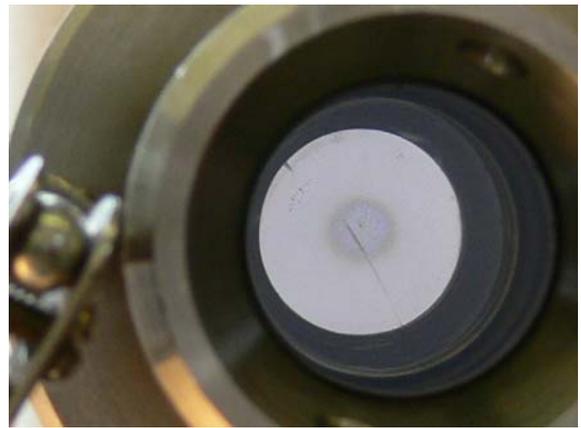

-27.5 °C

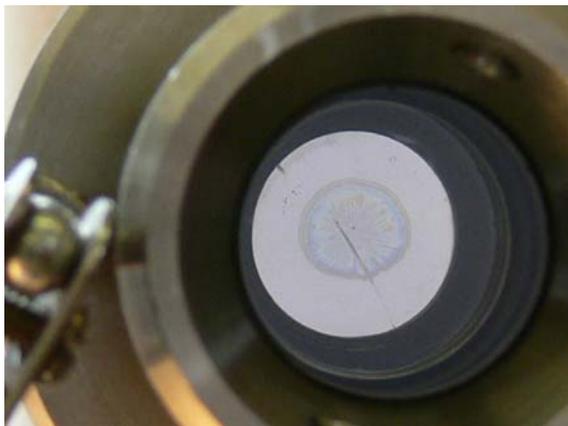

-28.0 °C

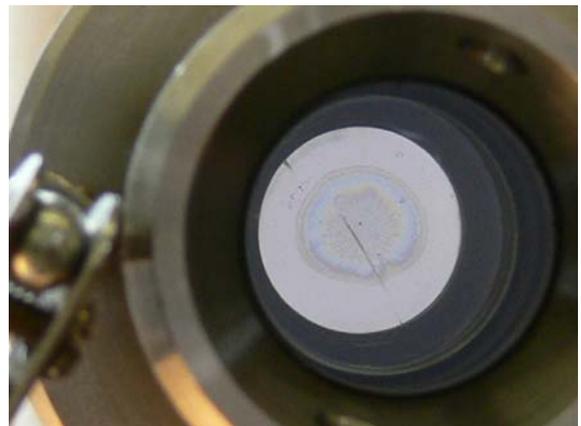

-28.5 °C

Gas G

Pressure = 16 bar

Assigned dewpoint = -31.5 °C



-30.0 °C



-30.5 °C



-31.0 °C



-31.5 °C



-32.0 °C



-32.5 °C